


Trace: 2

Condition : EN 55015 QP NEUTRAL
 EUT : 灯
 Test Model : ON mode
 Test Engineer: Li
 Remark : AC220V50Hz

	Read Freq	LISN Level	Cable Factor	Cable Loss	Level	Limit Line	Over Limit	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB	
1	0.150	43.79	9.85	0.01	53.65	66.00	-12.35	QP
2	0.150	18.97	9.85	0.01	28.83	56.00	-27.17	Average
3	0.176	46.82	9.91	0.01	56.74	64.68	-7.94	QP
4	0.176	33.58	9.91	0.01	43.50	54.68	-11.18	Average
5	0.267	33.23	9.85	0.01	43.09	61.20	-18.11	QP
6	0.267	18.29	9.85	0.01	28.15	51.20	-23.05	Average
7	0.529	26.64	9.79	0.01	36.44	56.00	-19.56	QP
8	0.529	12.25	9.79	0.01	22.05	46.00	-23.95	Average
9	1.249	22.37	9.63	0.03	32.03	56.00	-23.97	QP
10	1.249	7.79	9.63	0.03	17.45	46.00	-28.55	Average

Condition : EN 55015 QP NEUTRAL
 EUT : 灯
 Test Model : ON mode
 Test Engineer: Li
 Remark :

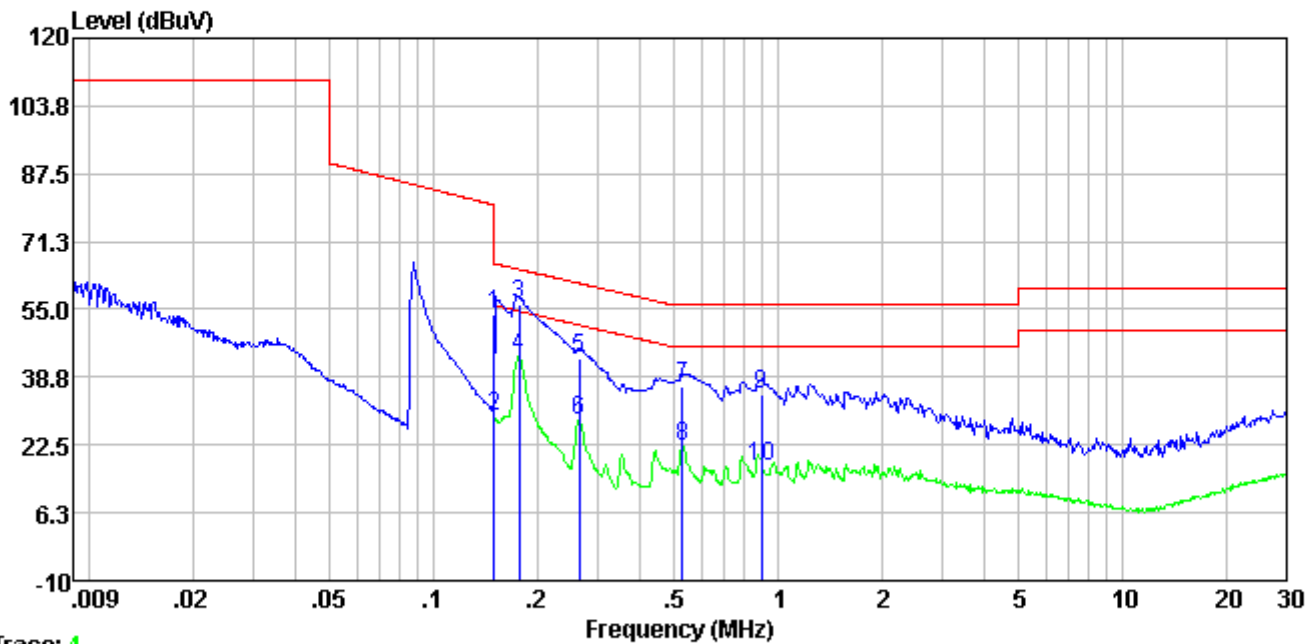

Trace: 4

Condition : EN 55015 QP LINE
 EUT : 灯
 Test Model : ON mode
 Test Engineer: Li
 Remark : AC220V50Hz

	Read Freq	LISN Level	Cable Factor	Cable Loss	Level	Limit Line	Over Limit	Remark
	MHz	dBuV	dB	dB	dBuV	dBuV	dB	
1	0.150	43.74	10.05	0.01	53.80	66.00	-12.20	QP
2	0.150	19.08	10.05	0.01	29.14	56.00	-26.86	Average
3	0.178	46.25	9.79	0.01	56.05	64.59	-8.54	QP
4	0.178	33.89	9.79	0.01	43.69	54.59	-10.90	Average
5	0.266	33.63	9.62	0.01	43.26	61.25	-17.99	QP
6	0.266	18.71	9.62	0.01	28.34	51.25	-22.91	Average
7	0.529	26.82	9.79	0.01	36.62	56.00	-19.38	QP
8	0.529	12.22	9.79	0.01	22.02	46.00	-23.98	Average
9	0.899	24.73	9.70	0.03	34.46	56.00	-21.54	QP
10	0.899	7.73	9.70	0.03	17.46	46.00	-28.54	Average

Condition : EN 55015 QP LINE
 EUT : 灯
 Test Model : ON mode
 Test Engineer: Li
 Remark :